


DESCRIPTION AND OPERATION (Continued)

Heater System Vacuum Schematic and Selector Test

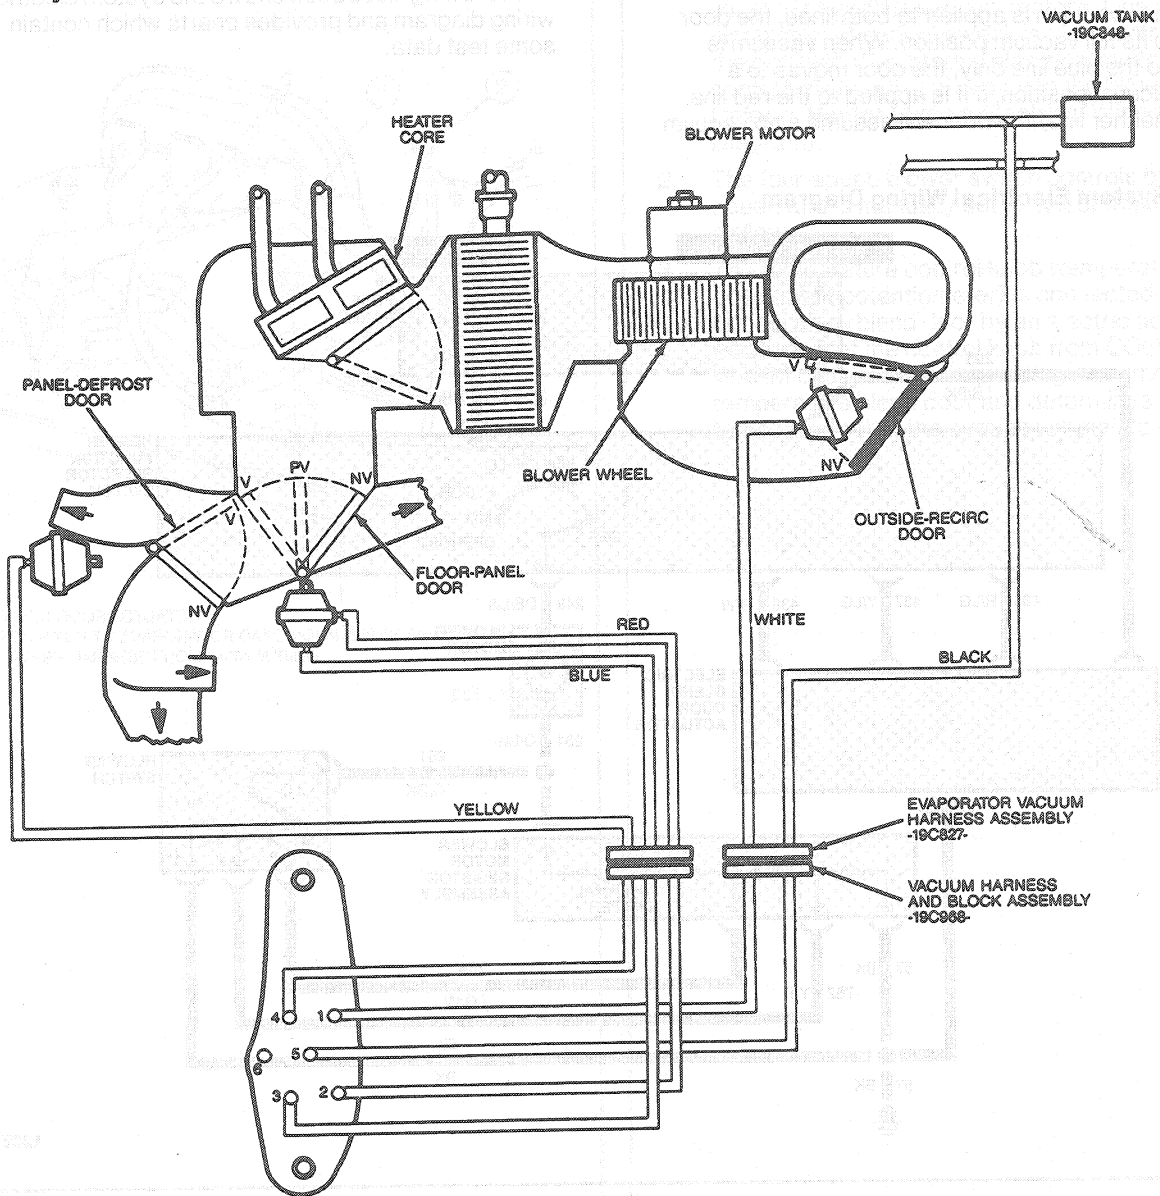

VACUUM PORT	FUNCTION	SELECTION						
		OFF	DEFROST	FLOOR — PANEL (MIX)	FLOOR	FLOOR — PANEL (HI-LO)	PANEL	RECIRC.
1	Outside — Recirc.	V	NV	NV	NV	NV	NV	V
2	Full Floor	NV	NV	NV	V	NV	NV	NV
3	Floor — Panel (Partial)	NV	NV	V	V	V	NV	NA
4	Panel — Defrost	NV	NV	NV	NV	V	V	V
5	Source	V	V	V	V	V	V	V
6	Plugged	—	—	—	—	—	—	—

CCL 2557-B